

# Smart Layer™



## Principles of Operation


The Smart Layer™ system is a Chart patented feature that provides an early indication of fatigue damage occurring in a brazed aluminum heat exchanger (BAHX) prior to any loss of process fluid containment. It operates on the fact that thermal fatigue typically accumulates fastest in the outside cap and parting sheets. For BAHX equipped with Smart Layer™ technology, an outside dummy layer is converted into a pressurized inactive layer charged with low-pressure nitrogen. By monitoring the Smart Layer™ pressure while the BAHX is in operation, an operator can determine if any fatigue cracks have formed in the outer parting sheets.

### Key Features:


- Rated to MAWP of adjacent stream or higher
- Proven through successful field operation
- Repairable

### Value Added:

- Early indication of fatigue damage prior to any loss of containment
- Passive protection – peace of mind
- Field proven to reduce risk and increase uptime
- Low cost insurance to protect against unplanned shutdowns

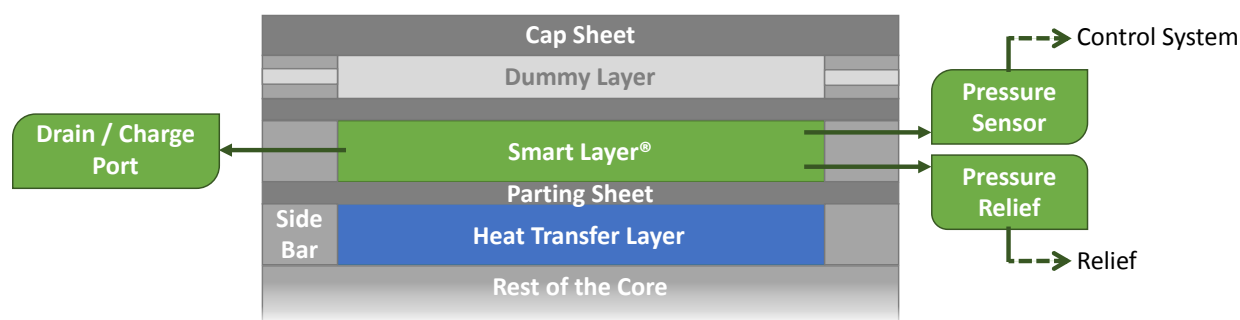

In practice, a user may install a BAHX equipped with Smart Layer™ technology and, if they operate within the guidelines, will never see an indication of fatigue damage. In other instances, such as in severe service applications, the BAHX may operate normally for years before a fatigue indication occurs. When it does, the user is able to continue operating, but should plan to repair the unit within 3 months.


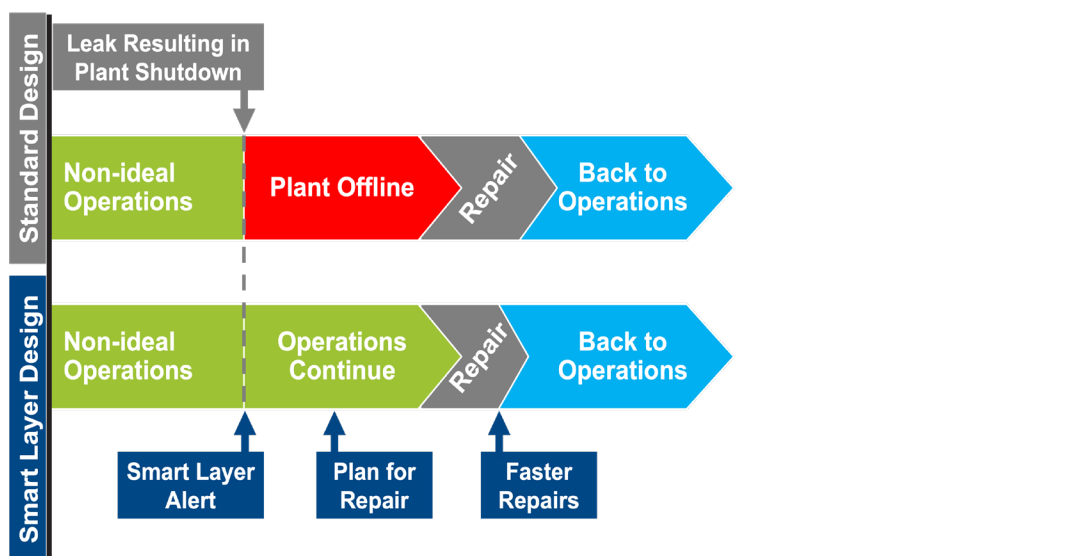


### Outside sheet crack

Drop in Smart Layer™ pressure

Inert charge vents

No process fluid leaking

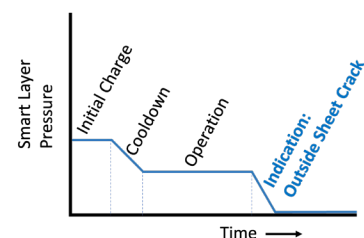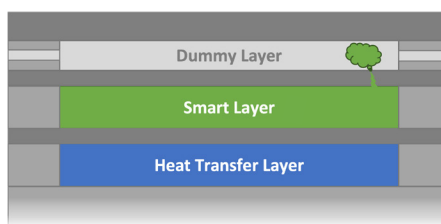




### Inside sheet crack

Process fluid enters Smart Layer™ stream

Rise in Smart Layer™ pressure

Process fluid contained by  
Smart Layer™ stream


No process fluid leaking

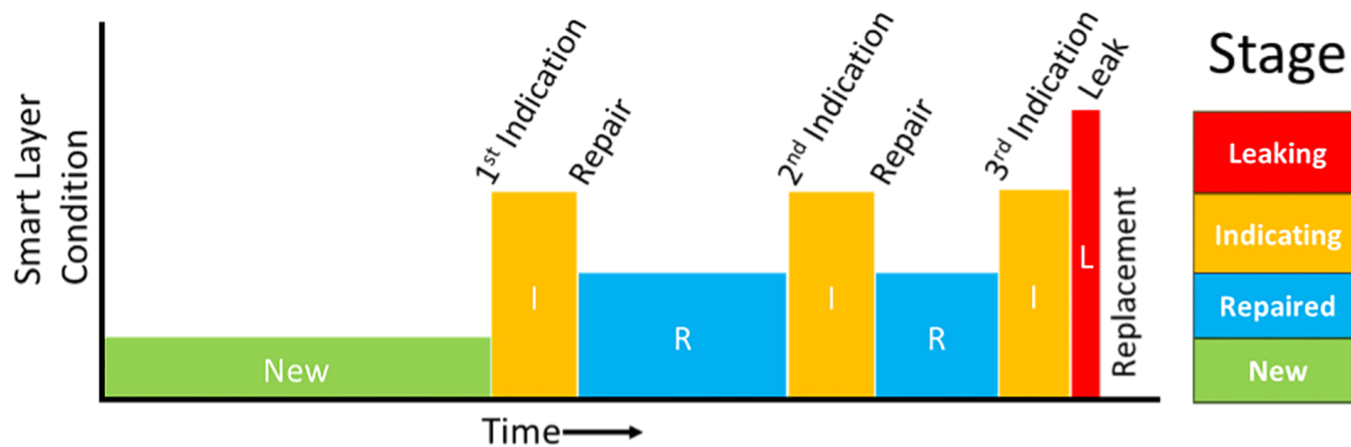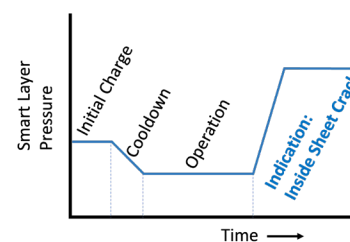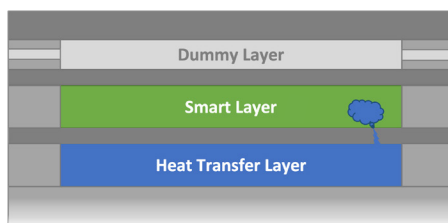

\*Chart recommends replacing a BAHX after the second repair.

## Design Example

The typical Smart Layer™ design will include 2 additional headers dedicated to the Smart Layer™ stream. The bottom header will have a single nozzle for charging with nitrogen and draining liquids. The top header will have 2 nozzles: one for a pressure transmitter and one for a pressure relief system.

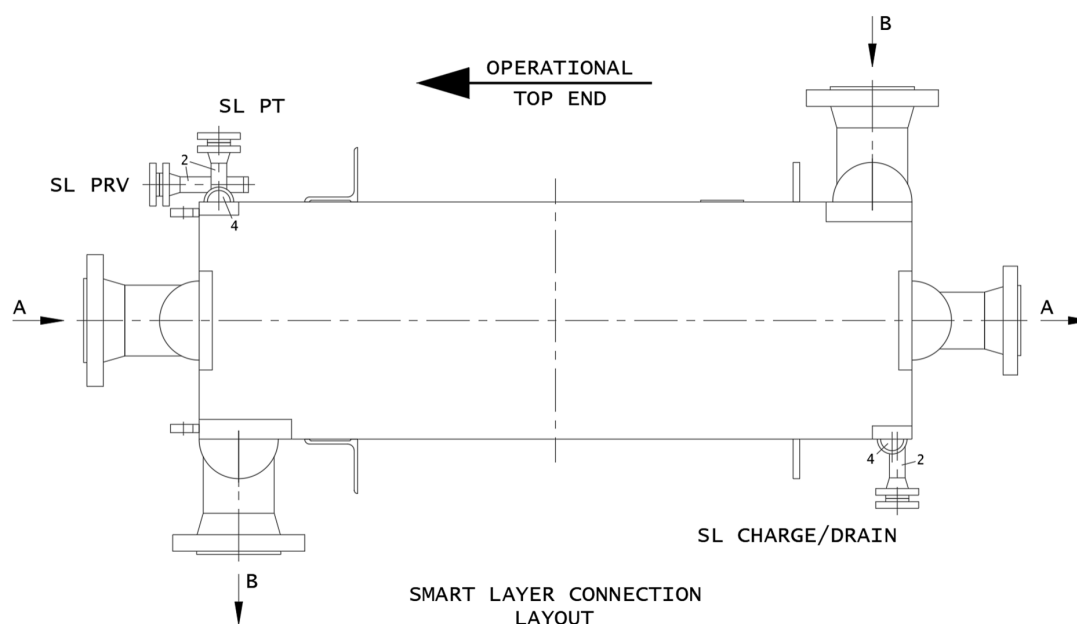

## Configuration

A Smart Layer™ system is provided in different design pressure and pressure relief configurations.

### Design Pressure

The Smart Layer™ stream design pressure is determined by Chart and the customer, considering the unique characteristics and repairability of the specific BAHX design.

DESIGN PRESSURE	PRESSURE RELIEF
High Pressure	Self Contained or External
Low Pressure	External



### “High-Pressure” (HP-SL)

The Smart Layer™ stream is rated to the MAWP of the highest-pressure stream in the unit. This will be able to contain a leak from any stream, even non-adjacent ones, into the Smart Layer™ stream. It can accommodate self-contained or external pressure relief.

### “Low-Pressure” (LP-SL)

The Smart Layer™ stream is rated to the MAWP of the adjacent stream, which is typically the lowest-pressure stream in the unit. This is sufficient for most circumstances, as the most likely Smart Layer™ indication leak will be from the adjacent layer. This also simplifies repairs to restore Smart Layer™ functionality should an indication occur. This is only compatible with external pressure relief.

# Pressure Relief Comparison

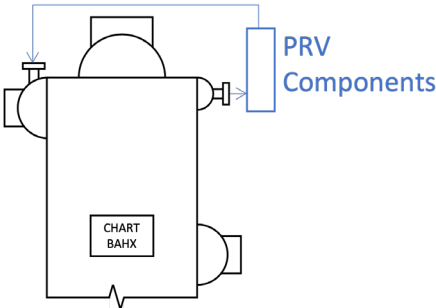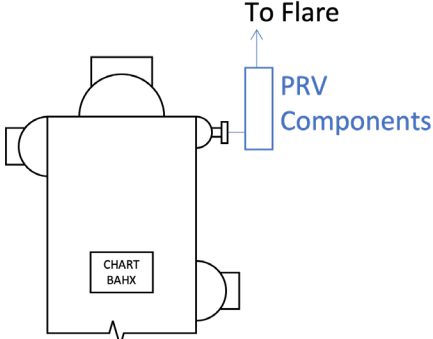	Self-Contained Relief	External Relief
		
Smart Layer™ Design Configuration	HP-SL	HP-SL or LP-SL
PRV Line Outlet	Low-pressure process stream	External piping / flare
Flanged Connections	Optional	Optional
Cold Box Compatible	No	Yes, with welded connections

## Self-Contained Relief

The self-contained pressure relief configuration eliminates the need for an external PRV loop or flare connection by directing the Smart Layer™ pressure relief to a low-pressure header on the BAHX unit. The customer is responsible for sizing and sourcing pressure relief components. This configuration assumes appropriate pressure relief on the low-pressure stream and sufficient pressure differential between the Smart Layer™ stream MAWP and low-pressure stream MAWP. Only compatible with High-Pressure Smart Layer™ designs.

## Schematic Examples of Self-Contained PRV System:



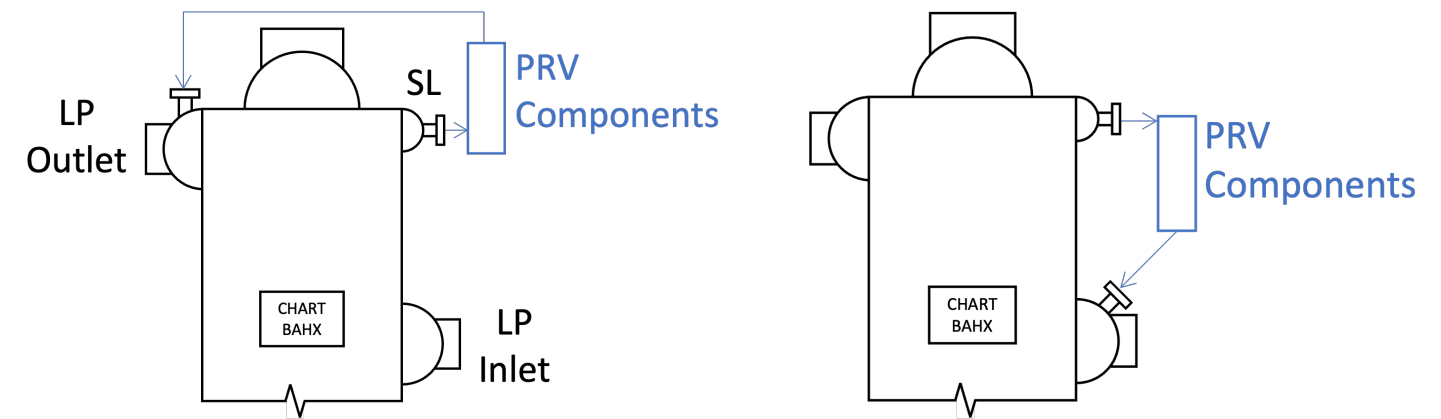



Chart Scope:

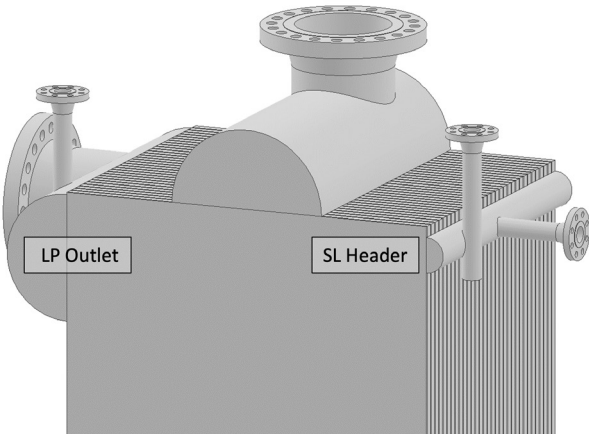

3D Example Self-Contained PRV System  
(Customer Scope):

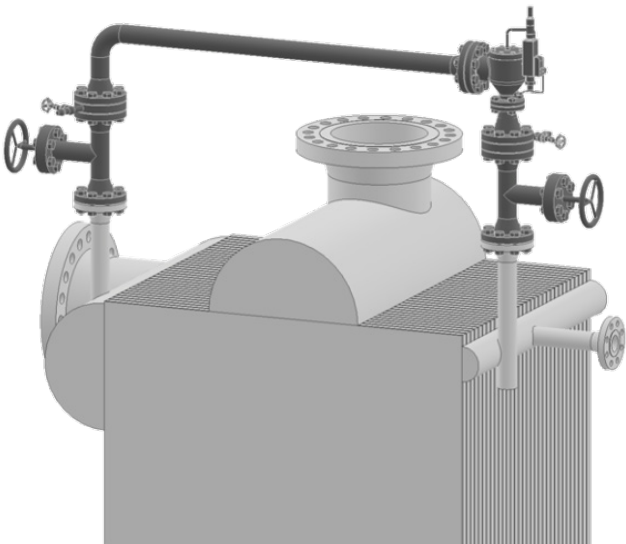

Suggested Self-Contained PRV Loop Components

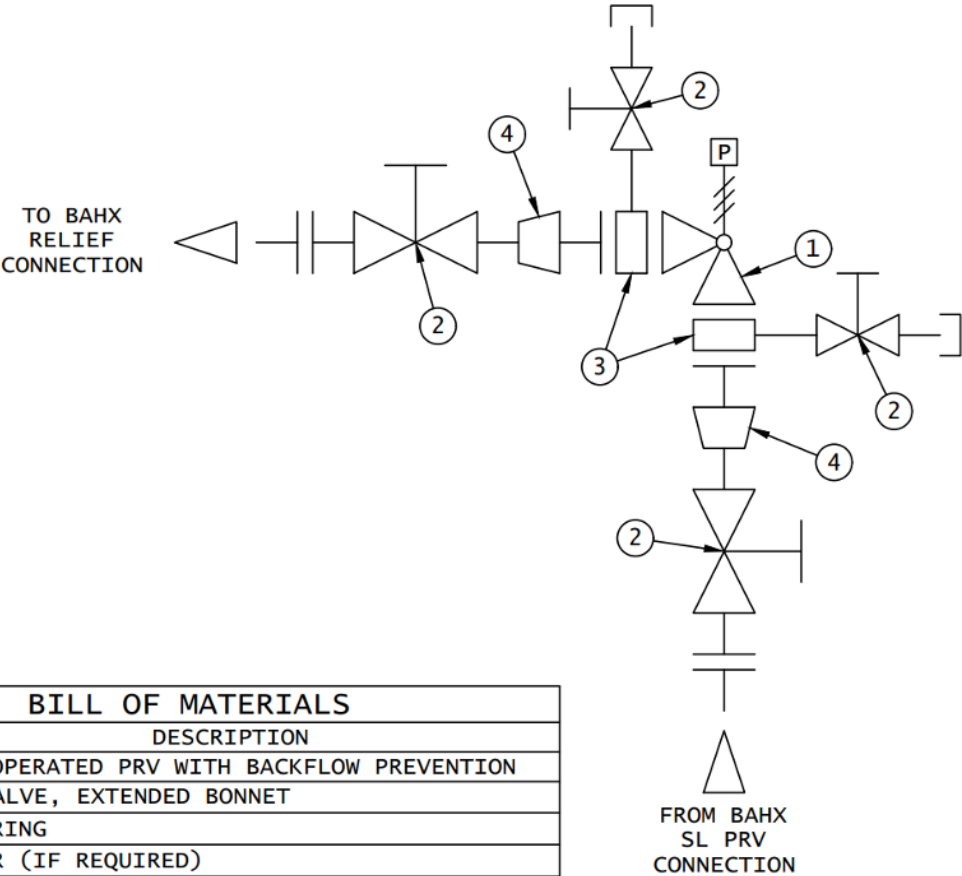



BILL OF MATERIALS	
ITEM	DESCRIPTION
1	PILOT OPERATED PRV WITH BACKFLOW PREVENTION
2	GATE VALVE, EXTENDED BONNET
3	BLEED RING
4	REDUCER (IF REQUIRED)




## External Relief

The external relief configuration allows the Smart Layer™ pressure relief to be directed to an external PRV loop or flare in the customer's scope. The customer is responsible for sizing and sourcing pressure relief components. Compatible with High-Pressure and Low-Pressure Smart Layer™ designs.

## Schematic Examples of External PRV System:

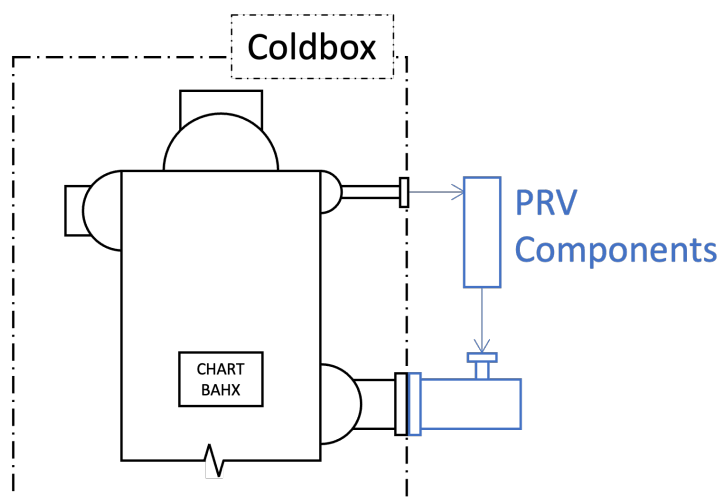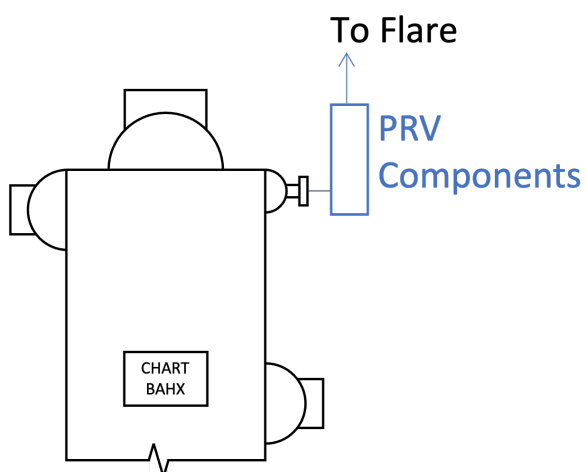

## Chart Scope:

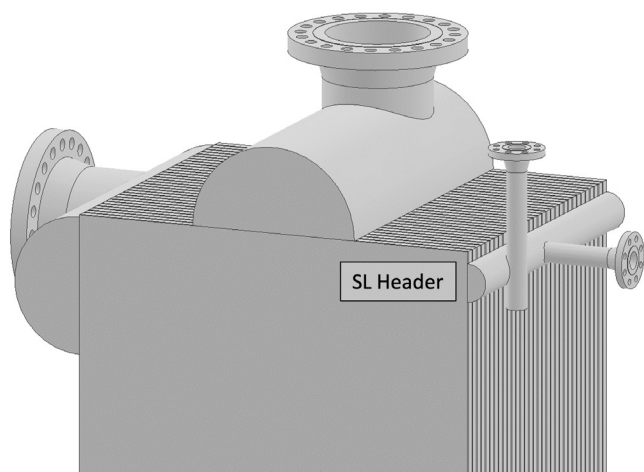

## PRV Selection

The Smart Layer™ stream must be provided with dedicated pressure relief. The guidance provided here is based on Chart's experience, which may not be applicable to a specific application. The customer is ultimately responsible for selecting an appropriate pressure relief system for their application.

## Typical Hardware

Where the pressure relief is directed into a low-pressure process stream, a modulating pilot operated valve with back-flow prevention is recommended. Where relief is routed directly to an atmospheric flare, a conventional spring PRV is recommended. Stainless steel body material is recommended when cryogenic temperatures are possible within the exchanger or during relief events.

## Sizing Guidance

Chart recommends sizing the PRV using API 521 (7th Ed.) based on the following cases, which are intended to be conservative ("worst-case" requiring maximum relief flow). Each case should be reviewed for suitability to the specific installation by an engineer qualified in sizing pressure relief systems. Perform the sizing calculations for all process streams, but the controlling case is typically the process stream with the lowest molecular weight vapor.

Case 1: Pool Fire and Case 2: Loss of Refrigeration apply to High and Low-Pressure Smart Layer™ designs. Case 3: HP Leak to SL only applies to Low-Pressure Smart Layer™ designs and typically controls.

Assumptions common to all cases:

1. A leak has developed between the Smart Layer™ stream and a process stream, and the Smart Layer™ stream has filled with the process stream fluid. Neglect any residual Smart Layer™ nitrogen charge.
2. All pressure relief must flow through the PRV (no allowance for pressure relief through the original leak).
3. For worst case, assume the Smart Layer™ temperature is the cold end operating temperature. If this is too conservative, use typical operating conditions.

Case 1 and Case 2 sizing (HP and LP Smart Layer™ designs):

4. Assume Smart Layer™ stream is at MAWP of the process stream prior to heating.
5. Size for maximum rate of vapor formation as described in API 521 section 4.4.13.2.5.2<sup>1</sup>

Case 3 sizing (LP Smart Layer™ designs):

6. Size for a leak between the highest MAWP stream and the Smart Layer™ stream.

---

<sup>1</sup> For simple vaporizing liquid, the relieving rate is the heat input to Smart Layer™ stream divided by the latent heat of vaporization (API suggests assuming 50 BTU/lb if actual values are unavailable)



### Case 1: Pool Fire

BAHX is exposed to an open pool fire. Size using API 521 Section 4.4.13.2

<b>EXPOSED AREA</b>	BOTH CAP SHEET AREAS (BAHX WIDTH * LENGTH * 2)
<b>EXPOSED VOLUME</b>	SMART LAYER™ STREAM VOLUME
<b>MAXIMUM WALL TEMPERATURE</b> $T_w$	600 °F

### Case 2: Loss of Refrigeration

All cold stream flow suddenly stops but all warm stream flow continues, rapidly warming the entire BAHX to the warm end temperature. Size using API 521 Section 4.4.9.1.

<b>WARM SIDE DUTY</b> $Q_w$	SUM OF ALL WARM STREAM DUTIES
<b>NON-WARM LAYERS</b> $L_{NW}$	NUMBER OF NON-WARM STREAM LAYERS
<b>HEAT INPUT TO SMART LAYER™ STREAM</b> $Q$	$Q = \frac{Q_w}{L_{NW}}$


### Case 3: HP leak to SL

<b>CRACK SIZE</b>	0.15 IN <sup>2</sup> (1mm X 100mm)
-------------------	------------------------------------

## Example Design Specific Instructions

All units equipped with Smart Layer™ technology will include instructions specific to that unit.

When the Smart Layer™ stream is initially charged after installation or recharged after a repair, consult the Smart Layer™ Charge Pressure table for the appropriate charge pressure. This table accounts for the change in BAHX temperature so that the target Smart Layer™ pressure is achieved at operating conditions.

 <b>Chart Energy &amp; Chemicals, Inc.</b>				<b>Document</b> SL Charge Pressure Guidance																											
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%;"><b>PROJECT</b></td> <td>Example</td> </tr> <tr> <td><b>Unit</b></td> <td>E-01</td> </tr> <tr> <td><b>Spec Sheet</b></td> <td>123456X</td> </tr> <tr> <td><b>JDE</b></td> <td>1234.X</td> </tr> </table>				<b>PROJECT</b>	Example	<b>Unit</b>	E-01	<b>Spec Sheet</b>	123456X	<b>JDE</b>	1234.X	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td>Calc</td> <td style="text-align: center;">-</td> </tr> <tr> <td>Date</td> <td style="text-align: center;">-</td> </tr> <tr> <td>Checked</td> <td style="text-align: center;">-</td> </tr> <tr> <td>Date</td> <td style="text-align: center;">-</td> </tr> </table>		Calc	-	Date	-	Checked	-	Date	-										
<b>PROJECT</b>	Example																														
<b>Unit</b>	E-01																														
<b>Spec Sheet</b>	123456X																														
<b>JDE</b>	1234.X																														
Calc	-																														
Date	-																														
Checked	-																														
Date	-																														
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="2" style="text-align: left;">DOWNSTREAM SL RELIEF CONNECTION</th> </tr> <tr> <td colspan="2" style="text-align: center;">External</td> </tr> </table>		DOWNSTREAM SL RELIEF CONNECTION		External		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="2" style="text-align: left;">SL ALARM SETTINGS</th> </tr> <tr> <td>SL Operating</td> <td>[psig] 50</td> </tr> <tr> <td>High Alarm</td> <td>[psig] 80</td> </tr> <tr> <td>Low Alarm</td> <td>[psig] 30</td> </tr> </table>		SL ALARM SETTINGS		SL Operating	[psig] 50	High Alarm	[psig] 80	Low Alarm	[psig] 30																
DOWNSTREAM SL RELIEF CONNECTION																															
External																															
SL ALARM SETTINGS																															
SL Operating	[psig] 50																														
High Alarm	[psig] 80																														
Low Alarm	[psig] 30																														
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="2" style="text-align: left;">BAHX PRIMARY OPERATING CONDITIONS</th> </tr> <tr> <td>Case</td> <td>Main Operation</td> </tr> <tr> <td>Warm End</td> <td>[F] 60</td> </tr> <tr> <td>Cold End</td> <td>[F] -40</td> </tr> </table>		BAHX PRIMARY OPERATING CONDITIONS		Case	Main Operation	Warm End	[F] 60	Cold End	[F] -40	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th style="text-align: center;">UNIFORM BAHX TEMPERATURE</th> <th style="text-align: center;">SL CHARGE PRESSURE</th> </tr> <tr> <th style="text-align: center;">[F]</th> <th style="text-align: center;">[psig]</th> </tr> <tr><td style="text-align: center;">100</td><td style="text-align: center;">62</td></tr> <tr><td style="text-align: center;">80</td><td style="text-align: center;">60</td></tr> <tr><td style="text-align: center;">60</td><td style="text-align: center;">57</td></tr> <tr><td style="text-align: center;">40</td><td style="text-align: center;">54</td></tr> <tr><td style="text-align: center;">20</td><td style="text-align: center;">51</td></tr> <tr><td style="text-align: center;">0</td><td style="text-align: center;">49</td></tr> <tr><td style="text-align: center;">-20</td><td style="text-align: center;">46</td></tr> <tr><td style="text-align: center;">10</td><td style="text-align: center;">50</td></tr> </table>		UNIFORM BAHX TEMPERATURE	SL CHARGE PRESSURE	[F]	[psig]	100	62	80	60	60	57	40	54	20	51	0	49	-20	46	10	50
BAHX PRIMARY OPERATING CONDITIONS																															
Case	Main Operation																														
Warm End	[F] 60																														
Cold End	[F] -40																														
UNIFORM BAHX TEMPERATURE	SL CHARGE PRESSURE																														
[F]	[psig]																														
100	62																														
80	60																														
60	57																														
40	54																														
20	51																														
0	49																														
-20	46																														
10	50																														
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="2" style="text-align: left;">PRV SIZING GUIDANCE</th> </tr> <tr> <td colspan="2"><b>Pool Fire</b></td> </tr> <tr> <td style="text-align: center;">Exposed Fire Area</td> <td style="text-align: center;">SL Volume</td> </tr> <tr> <td style="text-align: center;">[ft^2]</td> <td style="text-align: center;">[ft^3]</td> </tr> <tr> <td style="text-align: center;">96.0</td> <td style="text-align: center;">2</td> </tr> <tr> <td colspan="2"><b>Loss of Refrigeration</b></td> </tr> <tr> <td style="text-align: center;">Warm Side Duty</td> <td style="text-align: center;"># Non-Warm layers</td> </tr> <tr> <td style="text-align: center;">[BTU/hr]</td> <td style="text-align: center;">[-]</td> </tr> <tr> <td style="text-align: center;">1.23E+07</td> <td style="text-align: center;">100</td> </tr> </table>		PRV SIZING GUIDANCE		<b>Pool Fire</b>		Exposed Fire Area	SL Volume	[ft^2]	[ft^3]	96.0	2	<b>Loss of Refrigeration</b>		Warm Side Duty	# Non-Warm layers	[BTU/hr]	[-]	1.23E+07	100	<p>SL filling pressure at different BAHX temperatures to achieve target pressure at BAHX operating temperatures</p>											
PRV SIZING GUIDANCE																															
<b>Pool Fire</b>																															
Exposed Fire Area	SL Volume																														
[ft^2]	[ft^3]																														
96.0	2																														
<b>Loss of Refrigeration</b>																															
Warm Side Duty	# Non-Warm layers																														
[BTU/hr]	[-]																														
1.23E+07	100																														
<p>For BAHX in batteries, PRV sizing guidance is per each individual core</p>		<p style="text-align: right;">&lt;-- Equivalent Operating Condition</p>																													
<small>© 2025 Chart Energy &amp; Chemicals, Inc. All Rights Reserved</small>																															

## Operation

### Installation

1. Connect the PRV, pressure transmitter, and charge / drain components.
2. Perform leak test.

### Setup

1. Connect pressure transmitter to control system.
2. Configure Smart Layer™ high / low pressure alarms.
3. Pressurize Smart Layer™ stream with nitrogen.
4. Disconnect Smart Layer™ stream from nitrogen source.

### Monitoring

Daily visual inspection should be carried out to confirm no errant leaks. There is a small chance that a parting sheet and cap sheet crack will occur simultaneously and the high / low pressure alarms will not activate.

If a high-pressure alarm activates:

1. A crack has occurred between the Smart Layer™ stream and a process stream.
2. The Smart Layer™ stream is now “Indicating”.
3. Consider the Smart Layer™ stream to be filled with fluid from the adjacent process stream.

If a low-pressure alarm activates:

1. Either a crack has occurred in the cap sheet, or a leak has occurred in the associated Smart Layer™ piping system.
2. Re-pressurize the Smart Layer™ stream to confirm leak location. Check the dummy layer vent stubs first.
3. If leak is from vent stubs or BAHX core, the Smart Layer™ stream is now “Indicating”.
4. If leak is from associated piping system fittings, seal leak and retest.

### Indication Response:

1. The BAHX may continue to operate as long as no external process fluid leaks appear.
2. Report indication to Chart.
3. Review operations for root cause of crack. Thermal fatigue damage is a common cause.
4. Make plans to repair the BAHX. No further indications of fatigue damage will occur until repairs are made.
5. In most instances, Smart Layer™ functionality can be restored after repairs have been made.

# Smart Layer™

**For more information:**

<https://www.chartindustries.com/Products/Brazed-Aluminum-Heat-Exchangers>

*"Introducing Smart Layer™" Chart Industries, Sept 2018*

*"A Smarter System" Hydrocarbon Engineering, Dec 2018*

*"BAHX Fatigue – Smart Layer™ Indications versus Simulation Estimations" and*

*"Smart Layer™ Saves the Day" GPA Midstream Technical Conference, Apr 2024*



*Cooler By Design®*